
BROWN WATER UPDATE

March 28, 2005

CITY OF DOVER

DEPARTMENT OF PUBLIC WORKS

WATER QUALITY COMPLAINTS

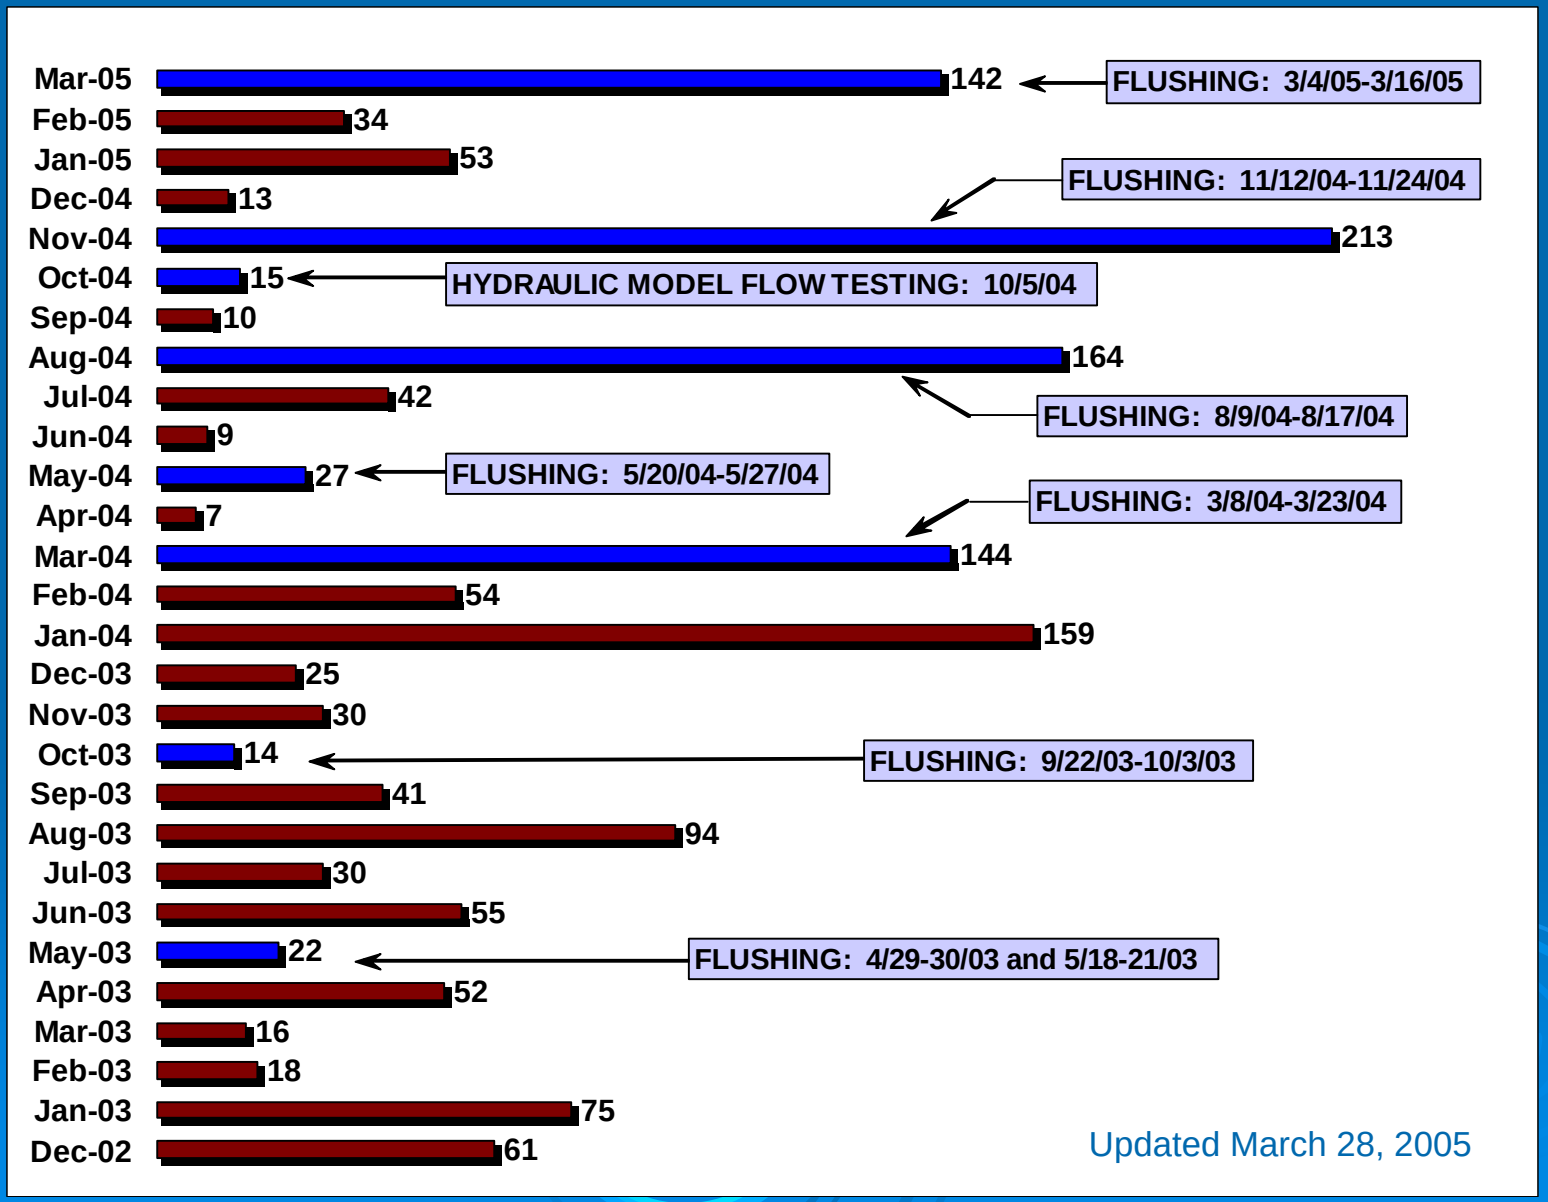

Updated March 28, 2005


Water System Plan of Action Summary

ACTION ITEM	COMPLETE	IN PROGRESS	INACTIVE	COMMENTS
1. System Flushing				Quarterly – Maintenance Operations
2. WTP Maintenance				Annual – Maintenance Operations
3. Well #2 Online				VFD Installation Pending
4. Water Quality RFQ				Consultant Selected 9/2004 Committee Action Form 1/2005
5. pH Control				Continuous - Operations
6. WTP Baseline Flow				Future Strategy
7. Improve Stable Flow				Continuous – Maintenance Operations
8. Unidirectional Flushing				Related to Master Plan
9. Reline/Replace Pipe				Long Term Program Being Developed
10. Corrosion Inhibitor				Part of Water Quality Consultant Scope of Work


Updated March 28, 2005

AREAS OF CONCERN

- FOURTEEN-INCH UNLINED CAST IRON PIPE (14” UCIP)
  - 1955-1959
  - DIVISION STREET, BAYARD AVENUE, COURT STREET, ROUTE 13, PINE STREET NORTH ALLEY

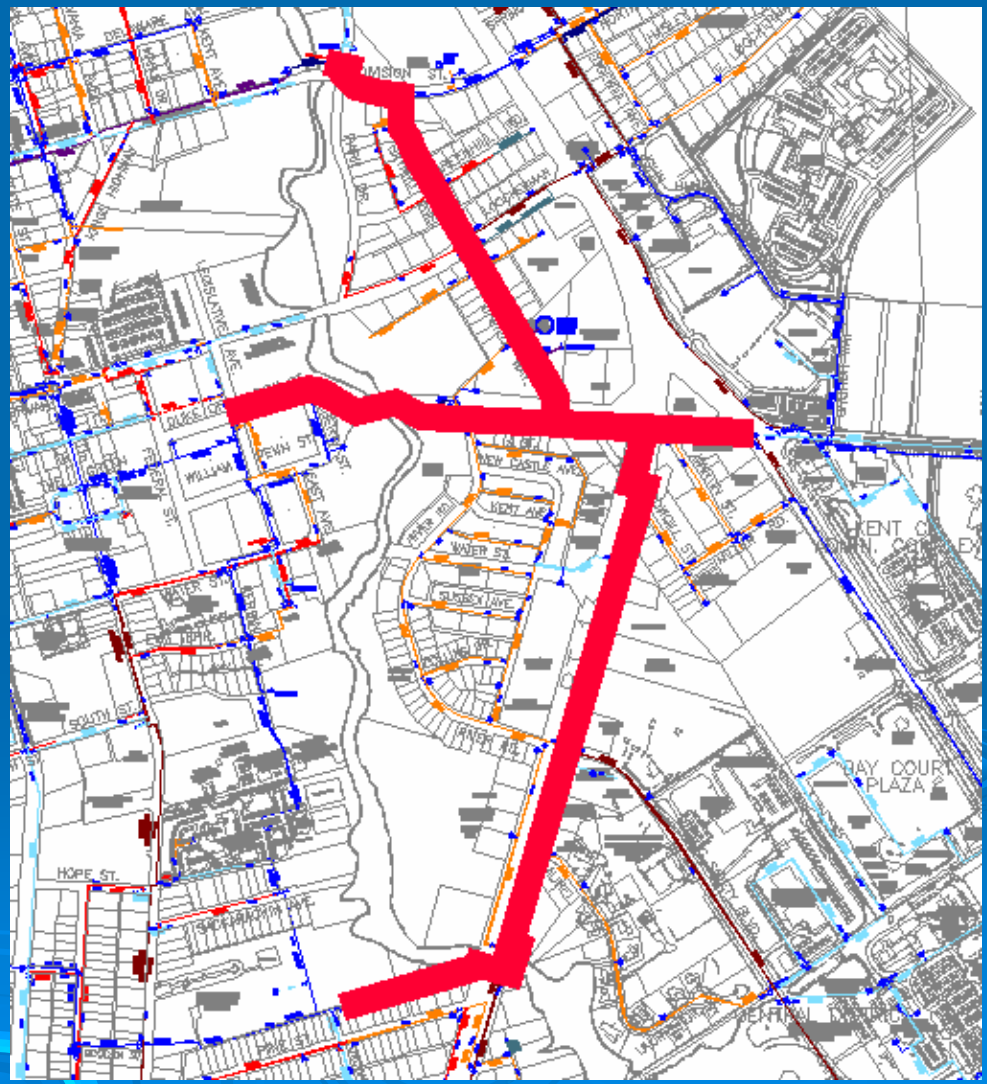

AREAS OF CONCERN

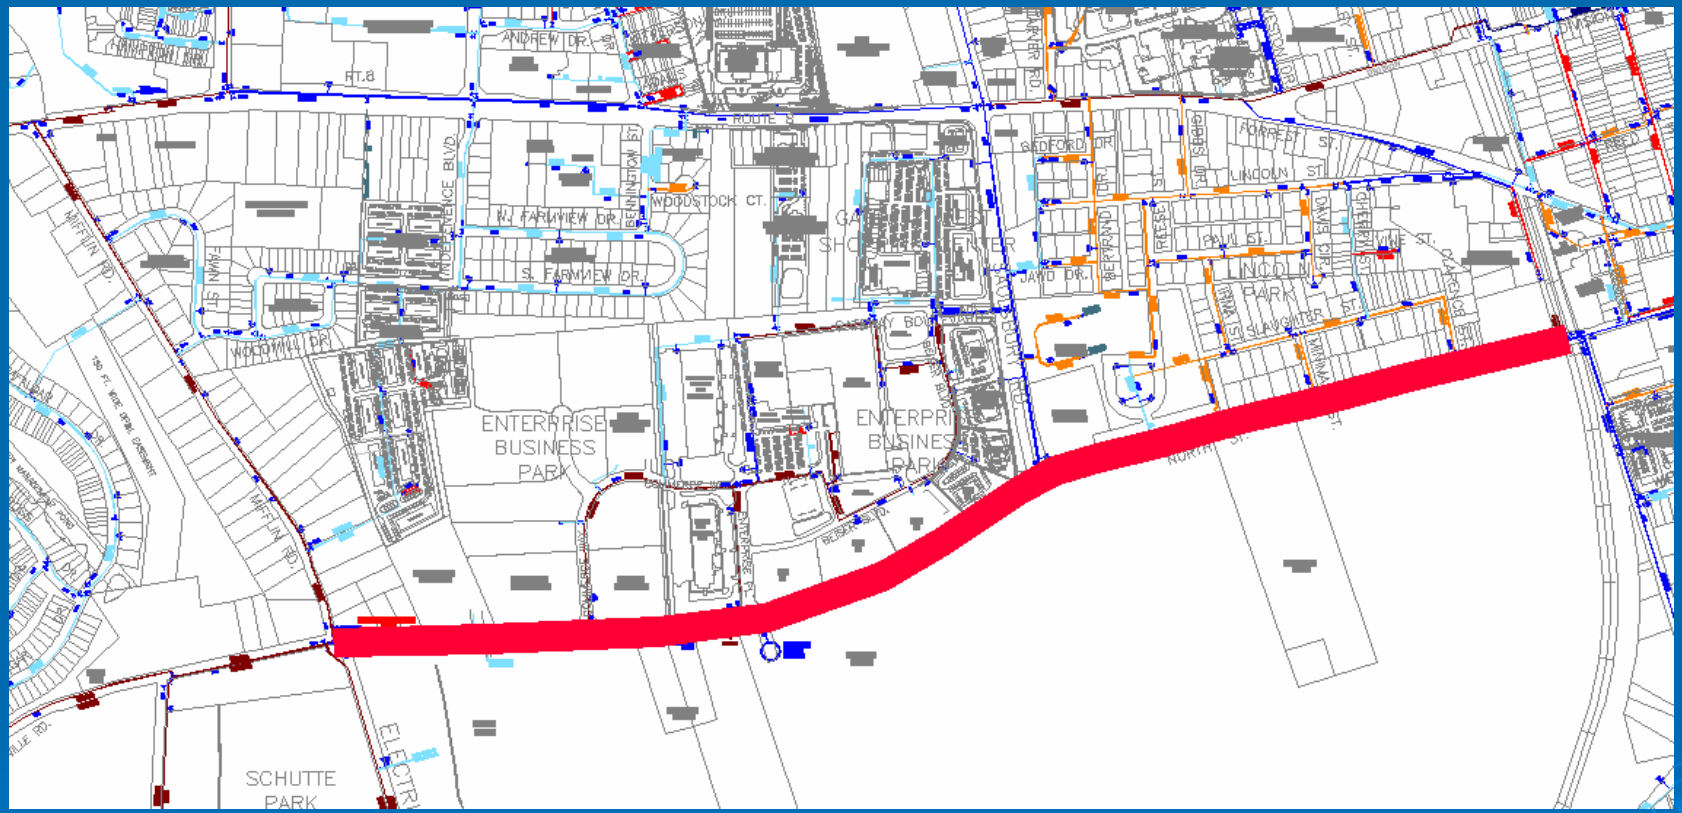

- TWELVE-INCH CAST IRON PIPE (12” CIP)
  - 1960-1977
  - NORTH STREET